


Request for Bid Proposal		Marshall University Office of Purchasing One John Marshall Drive Huntington, WV 25755-4100	Bid# R2401708
		Direct all inquiries regarding this order to: (304) 696-2599	Addendum No. 03

Vendor:	For information call: Purchasing Contact: Michelle Wheeler Phone: (304) 696-2727 Email: michelle.wheeler@marshall.edu & Purchasing@marshall.edu
---------	--

Sealed requests to bid for furnishing the supplies, equipment or services described below will be received by the Institution. TO RECEIVE CONSIDERATION FOR AWARD, UNLESS OTHERWISE NOTED, THE BID WILL BE SUBMITTED ON THIS FORM AND UPLOADED INTO THE MU BONFIRE PORTAL ON OR BEFORE THE DATE AND TIME SHOWN FOR THE BID OPENING. When applicable, prices will be based on units specified; and Bidders will enter the delivery date or time for items contained herein. The Institution reserves the right to accept or reject bids on each item separately or as a whole, to reject any or all bids, to waive informalities or irregularities and to contract as the best interests of the Institution may require. BIDS ARE SUBJECT TO THE GENERAL TERMS AND CONDITIONS AS SET FORTH HEREIN.

DATE 3/25/2024	Click here to enter text.	DEPARTMENT REQUISITION NO. R2401708	BIDS OPEN: 3:00 p.m. on 3/28/2024 via TEAMS Link: http://tinyurl.com/2m25rw9p	BIDDER MUST ENTER DELIVERY DATE FOR EACH ITEM BID
------------------------------	---------------------------	---	---	--

Item #	Quantity	Description	Unit Price	Extended Price
		<p style="text-align: center;"><u>ADDENDUM NO. 03</u></p> <p>Project Name: R2401708- MARSHALL HEALTH – FORMER STRAYER BUILDING RENOVATIONS</p> <p>To clarify specifications</p> <p>B. SPECIFICATIONS</p> <p>1. The following specification sections have been revised in this addendum: 096500 – Resilient Flooring 096813 – Tile Carpeting</p> <p>C. DRAWINGS</p> <p>1. A4.05, A7.01, and A7.02 have been revised in this addendum.</p>		

Total

To the Office of Purchasing,
In compliance with the above, the undersigned offers and agrees, if this offer is accepted within _____ calendar days (30 calendar days unless a different period is inserted by the purchaser) from the bid open date, specified above, to furnish any or all items upon which prices are offered, at the price set opposite each item, delivered at the designated point(s), within the time specified.

Bidder guarantees shipment from _____
within _____ days

FOB _____ After receipt of order at address shown
Terms _____

BOG 43

Bidder's name Vendor _____

Signed By _____

Typed Name _____

Title _____

Email _____

Street Address _____

City/State/Zip _____

Date _____ Phone _____

Fein _____

SOLICITATION NUMBER: R2401708

Addendum Number: No. 03

The purpose of this addendum is to modify the solicitation identified as ("Solicitation") to reflect the change(s) identified and described below.

Applicable Addendum Category:

- ☐ Modify bid opening date and time
- ☐ Modify specifications of product or service being sought
- ☐ Attachment of vendor questions and responses
- ☐ Attachment of pre-bid sign-in sheet
- ☐ Correction of error
- ☒ Other

Description of Modification to Solicitation:

Addendum issued to publish and distribute the attached documentation to the vendor community.

B. SPECIFICATIONS

1. The following specification sections have been revised in this addendum:
096500 – Resilient Flooring
096813 – Tile Carpeting

C. DRAWINGS

1. A4.05, A7.01, and A7.02 have been revised in this addendum.

NO OTHER CHANGES

Additional Documentation: Documentation related to this Addendum (if any) has been included herewith and is specifically incorporated herein by reference.

Terms and Conditions:

1. All provisions of the Solicitation and other addenda not modified herein shall remain in full force and effect.
2. Vendor should acknowledge receipt of all addenda issued for this Solicitation by completing an Addendum Acknowledgment, a copy of which is included herewith. Failure to acknowledge addenda may result in bid disqualification. The addendum acknowledgement should be submitted with the bid to expedite document processing.

**MARSHALL UNIVERSITY JOAN C EDWARDS SCHOOL OF MEDICINE
CABELL COUNTY, WEST VIRGINIA
MARSHALL HEALTH – FORMER STRAYER BUILDING RENOVATIONS**

ADDENDUM #3

March 25, 2024

THRASHER PROJECT #T60-11110

TO WHOM IT MAY CONCERN:

A Mandatory Pre-Bid Conference was held on Thursday, March 7, 2024, on the above-referenced project, A Mandatory Pre-Bid Walkthrough was conducted on Friday, March 8, 2024. The following are clarifications for the above reference project.

A. GENERAL
None

B. SPECIFICATIONS
1. The following specification sections have been revised in this addendum:
096500 – Resilient Flooring
096813 – Tile Carpeting

C. DRAWINGS
1. A4.05, A7.01, and A7.02 have been revised in this addendum.

If you have any questions or comments, please feel free to contact me at your earliest convenience. As a reminder, bids will be received until **3:00 p.m. on Thursday, March 28, 2024**. A bid that is not submitted electronically through Bonfire™ should contain the information listed below on the face of the envelope or the bid may be rejected by the University.

Bid Opening Location: Marshall University Office of Purchasing
Old Main 125
One John Marshall Drive Huntington, WV 25755

Good luck to everyone and thank you for your interest in the project.

Sincerely,

THE THRASHER GROUP, INC.



CASEY ARTHUR, MBA, AIA, NCARB, LEED AP
Project Manager

SECTION 096500 - RESILIENT FLOORING

PART 1 - GENERAL

1.1 SECTION INCLUDES

- A. Resilient sheet flooring.
- B. Resilient tile flooring.
- C. Resilient base.
- D. Installation accessories.

1.2 REFERENCE STANDARDS

- A. ASTM F1066 - Standard Specification for Vinyl Composition Floor Tile; 2004 (Reapproved 2018).
- B. ASTM F1700 - Standard Specification for Solid Vinyl Floor Tile; 2020.
- C. ASTM F1861 - Standard Specification for Resilient Wall Base; 2016.
- D. ASTM F1913 - Standard Specification for Vinyl Sheet Floor Covering Without Backing; 2019.

1.3 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide data on specified products, describing physical and performance characteristics; including sizes, patterns and colors available; and installation instructions.
- C. Verification Samples: Submit four samples, 6 by 6 inch in size illustrating color and pattern for each resilient flooring product specified.
- D. Concrete Subfloor Test Report: Submit a copy of the moisture and alkalinity (pH) test reports.

1.4 DELIVERY, STORAGE, AND HANDLING

- A. Store all materials off of the floor in an acclimatized, weather-tight space.
- B. Maintain temperature in storage area between 55 degrees F and 90 degrees F.

1.5 FIELD CONDITIONS

- A. Store materials for not less than 48 hours prior to installation in area of installation at a temperature of 70 degrees F to achieve temperature stability. Thereafter, maintain conditions above 55 degrees F.

PART 2 – PRODUCTS

2.1 SHEET FLOORING

- A. Vinyl Sheet Flooring – SVF 1: Homogeneous without backing, with color and pattern throughout full thickness.
1. Manufacturers: Subject to compliance with requirements, provide products by the following:
 - a. Basis of Design: Patcraft, Holistic Shades.
 - 1) Rep Contact: Kelly Harrison (614-867-7782) or Kelly.harrison@patcraft.com
 2. Minimum Requirements: Comply with ASTM F1913.
 3. Critical Radiant Flux (CRF): Minimum 0.45 watt per square centimeter, when tested in accordance with ASTM E 648 or NFPA 253.
 4. Total Thickness and Wear Layer Thickness: 0.080 inch nominal.
 5. Sheet Width: 72 inch minimum.
 6. Static Load Resistance: 250 psi minimum, when tested as specified in ASTM F970.
 7. Seams: Heat welded.
 8. Integral coved base with cap strip.
 9. Pattern: Sycamore 103922.
- B. Welding Rod: Solid bead in material compatible with flooring, produced by flooring manufacturer for heat welding seams, and in color matching field color.

2.2 TILE FLOORING

- A. Resilient Tile Flooring
1. Manufacturers: Subject to compliance with requirements, provide products by the following:
 - a. Basis of Design: Patcraft, Typography, Typeface and Letterpress. Colors as schedule on the drawings.
 - 1) Rep Contact: Kelly Harrison (614-867-7782) or Kelly.harrison@patcraft.com
 2. Minimum Requirements: Comply with ASTM F1700, of Class corresponding to type specified.
 3. Critical Radiant Flux (CRF): Minimum 0.45 watt per square centimeter, when tested in accordance with ASTM E 648 or NFPA 253.
 4. Mold and Microbial Resistance: Highly resistant when tested in accordance with ASTM D6329; certified in accordance with UL 2824.
 5. VOC Content Limits: As specified in Section 01 61 16.
 6. Tile Size: 24 by 24 inch.

- 7. Total Thickness: 0.098 inch.
- 8. Wear-layer Thickness: 20 mil
- 9. Pattern: As scheduled on drawings.

2.3 RESILIENT BASE

- A. Resilient Base: ASTM F1861, Type TS rubber, vulcanized thermoset; top set Style B, Cove.
 - 1. Manufacturers:
 - a. As scheduled on drawings.
- B. Height: 4 inch.
- C. Thickness: 0.125 inch thick.
- D. Finish: Satin.
- E. Length: Roll.
- F. Color: Color as selected from manufacturer's standards.
- G. Accessories: Premolded external corners and end stops.

2.4 ACCESSORIES

- A. Subfloor Filler: White premix latex; type recommended by adhesive material manufacturer.
- B. Primers, Adhesives, and Seam Sealer: Waterproof; types recommended by flooring manufacturer.
- C. Adhesive for Vinyl and Rubber Flooring:
 - 1. Manufacturers:
 - a. H.B. Fuller Construction Products, Inc; TEC Flexera Premium Universal Adhesive: www.tecspecialty.com/#sle.
 - b. Stauf USA, LLC; D737 High-Tack: www.staufusa.com/#sle.
- D. Moldings, Transition and Edge Strips: Same material as flooring.
- E. Copper Grounding Strips: Type and size as recommended by static control flooring manufacturer.
- F. Floor Polish for Static Control Flooring: Fluid-applied polish, intended to protect electrical properties of flooring, as recommended by static control flooring manufacturer.

2.5 FLOORING LOCATIONS

- A. See Finish Schedules and Floor Finish Plans for flooring locations.

PART 3 – EXECUTION

3.1 EXAMINATION

- A. Verify that surfaces are flat to tolerances acceptable to flooring manufacturer, free of cracks that might telegraph through flooring, clean, dry, and free of curing compounds, surface hardeners, and other chemicals that might interfere with bonding of flooring to substrate.
- B. Cementitious Subfloor Surfaces: Verify that substrates are ready for resilient flooring installation by testing for moisture and alkalinity (pH).
 - 1. Test in accordance with Section 09 05 61.
 - 2. Obtain instructions if test results are not within limits recommended by resilient flooring manufacturer and adhesive materials manufacturer.
 - a. Follow moisture and alkalinity remediation procedures in Section 09 05 61.

3.2 PREPARATION

- A. Prepare floor substrates as recommended by flooring and adhesive manufacturers.
- B. Remove subfloor ridges and bumps. Fill minor low spots, cracks, joints, holes, and other defects with subfloor filler to achieve smooth, flat, hard surface.
- C. Prohibit traffic until filler is fully cured.

3.3 INSTALLATION – GENERAL

- A. Starting installation constitutes acceptance of subfloor conditions.
- B. Install in accordance with manufacturer's written instructions.
- C. Adhesive-Applied Installation:
 - 1. Place copper grounding strip in conductive adhesive and apply additional adhesive to topside of strip before installing static control flooring. Allow strip to extend beyond flooring in accordance with static control flooring manufacturer's instructions. Refer to Section 26 05 26 for grounding and bonding to building grounding system.
 - 2. Fit joints and butt seams tightly.
 - 3. Set flooring in place, press with heavy roller to attain full adhesion.
- D. Where type of floor finish, pattern, or color are different on opposite sides of door, terminate flooring under centerline of door.
- E. Install edge strips at unprotected or exposed edges, where flooring terminates, and where indicated.
- F. Metal Strips: Attach to substrate before installation of flooring using stainless steel screws.
- G. Resilient Strips: Attach to substrate using adhesive.
- H. Scribe flooring to walls, columns, cabinets, floor outlets, and other appurtenances to produce tight joints.
- I. Install flooring in recessed floor access covers, maintaining floor pattern.
- J. At movable partitions, install flooring under partitions without interrupting floor pattern.

3.4 INSTALLATION - SHEET FLOORING

- A. Lay flooring with joints and seams parallel to longer room dimensions, to produce minimum number of seams. Lay out seams to avoid widths less than 1/3 of roll width; match patterns at seams.
- B. Seal seams by heat welding where indicated.
- C. Double cut sheet; provide heat welded seams.
- D. Coved Base: Install as detailed on drawings, using coved base filler as backing at floor to wall junction. Extend sheet flooring vertically to height indicated, cover top edge with metal cap strip.

3.5 INSTALLATION - TILE FLOORING

- A. Install in accordance with manufacturer's instructions.
- B. Mix tile from container to ensure shade variations are consistent when tile is placed, unless otherwise indicated in manufacturer's installation instructions.
- C. Spread only enough adhesive to permit installation of materials before initial set.
- D. Set flooring in place, press with heavy roller to attain full adhesion.
- E. Lay flooring with joints and seams parallel to building lines to produce symmetrical tile pattern.
- F. Install tile to ashlar pattern. Allow minimum 1/2 full size tile width at room or area perimeter.
- G. Where floor finishes are different on opposite sides of door, terminate flooring under centerline of door.
- H. Install edge strips at unprotected or exposed edges, where flooring terminates, and where indicated. Before installation of flooring, secure metal strips with stainless steel screws.
- I. Scribe flooring to walls, columns, cabinets, floor outlets, and other appurtenances to produce tight joints.

3.6 INSTALLATION - RESILIENT BASE

- A. Fit joints tightly and make vertical. Maintain minimum dimension of 18 inches between joints.
- B. Miter internal corners. At external corners, use premolded units. At exposed ends, used premolded units.
- C. Install base on solid backing. Bond tightly to wall and floor surfaces.
- D. Scribe and fit to door frames and other interruptions.

3.7 CLEANING

- A. Remove excess adhesive from floor, base, and wall surfaces without damage.
- B. Clean in accordance with manufacturer's written instructions.
- C. Clean, seal, and wax resistant flooring products in accordance with manufacturer's instructions.
 - 1. Work shall be performed by a professional floor cleaning crew using manufacturer's instructions.

3.8 PROTECTION

- A. Prohibit traffic on resilient flooring for 48 hours after installation.

END OF SECTION 096500

SECTION 096813 - TILE CARPETING

PART 1 - GENERAL

1.1 SUMMARY

- A. Section includes modular carpet tile.

1.2 PREINSTALLATION MEETINGS

- A. Preinstallation Conference: Conduct conference at Project site.

1.3 ACTION SUBMITTALS

- A. Product Data: For each type of product.
- B. Shop Drawings: For carpet tile installation, plans showing the following:
 - 1. Columns, doorways, enclosing walls or partitions, built-in cabinets, and locations where cutouts are required in carpet tiles.
 - 2. Carpet tile type, color, and dye lot.
 - 3. Type of subfloor.
 - 4. Type of installation.
 - 5. Pattern of installation.
 - 6. Pattern type, location, and direction.
 - 7. Pile direction.
 - 8. Type, color, and location of insets and borders.
 - 9. Type, color, and location of edge, transition, and other accessory strips.
 - 10. Transition details to other flooring materials.
- C. Samples: For each exposed product and for each color and texture required.

1.4 INFORMATIONAL SUBMITTALS

- A. Product test reports.
- B. Sample warranty.

1.5 CLOSEOUT SUBMITTALS

- A. Maintenance data.

1.6 QUALITY ASSURANCE

- A. Installer Qualifications: Certified by the International Certified Floorcovering Installers Association at the Commercial I certification level.

1.7 WARRANTY

- A. Special Warranty for Carpet Tiles: Manufacturer agrees to repair or replace components of carpet tile installation that fail in materials or workmanship within specified warranty period.

- 1. Warranty Period: 10 years from date of Substantial Completion.

PART 2 - PRODUCTS

2.1 CARPET TILE

- A. Manufacturers: Subject to compliance with requirements, provide products by the following:
 - a. Basis of Design – Interface, Shiver Me Timbers, 103922 Sycamore
- B. Color & Pattern: Color - As scheduled on drawings. Pattern – Ashlar; run grain in same direction.
- C. Materials:
 - 1. Tile Carpeting: Tufted, manufactured in one color dye lot.
 - a. Smoke Density: ASTM E-662 NBS smoke chamber less than 450.
 - b. Critical Radiant Flux: Minimum of 0.22 watts/sq cm, when tested in accordance with ASTM E648 or NFPA 253.
 - c. Surface Flammability Ignition: Pass ASTM D2859 (the “pill test”).
 - d. VOC Content: Provide CRI (GLP) certified product; in lieu of labeling, independent test report showing compliance is acceptable.
 - e. ADA Compliance: Meets the Guidelines as Set Forth in the Americans with Disabilities Act for Minimum Static Coefficient of Friction of 0.6 for Accessible Routes.
 - f. Static Control Fiber: Permanent.
 - g. Maximum Electrostatic Charge: 3 Kv. at 20 percent relative humidity.
- D. Applied Treatments:
 - 1. Soil-Resistance Treatment: Manufacturer's standard treatment.
 - 2. Antimicrobial Treatment: Manufacturer's standard treatment that protects carpet tiles as follows:
 - a. Antimicrobial Activity: Not less than 2-mm halo of inhibition for gram-positive bacteria, not less than 1-mm halo of inhibition for gram-negative bacteria, and no fungal growth, according to AATCC 174.

2.2 INSTALLATION ACCESSORIES

- A. Trowelable Leveling and Patching Compounds: Latex-modified, hydraulic-cement-based formulation provided or recommended by carpet tile manufacturer.
- B. Adhesives: Water-resistant, mildew-resistant, nonstaining, pressure-sensitive type to suit products and subfloor conditions indicated, that comply with flammability requirements for installed carpet tile, and are recommended by carpet tile manufacturer for releasable installation.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Concrete Slabs:
 - 1. Moisture Testing: Perform tests so that each test area does not exceed 1000 sq. ft., and perform no fewer than three tests in each installation area and with test areas evenly spaced in installation areas.
 - a. Anhydrous Calcium Chloride Test: ASTM F 1869. Proceed with installation only after substrates have maximum moisture-vapor-emission rate of 3 lb of water/1000 sq. ft. in 24 hours.
 - b. Relative Humidity Test: Using in situ probes, ASTM F 2170. Proceed with installation only after substrates have a maximum 75 percent relative humidity level measurement.
 - c. Perform additional moisture tests recommended in writing by adhesive and carpet tile manufacturers. Proceed with installation only after substrates pass testing.







3.2 PREPARATION

- A. General: Comply with CRI's "CRI Carpet Installation Standards" and with carpet tile manufacturer's written installation instructions for preparing substrates indicated to receive carpet tile.
- B. Use trowelable leveling and patching compounds, according to manufacturer's written instructions, to fill cracks, holes, depressions, and protrusions in substrates. Fill or level cracks, holes and depressions 1/8 inch wide or wider, and protrusions more than 1/32 inch unless more stringent requirements are required by manufacturer's written instructions.
- C. Concrete Substrates: Remove coatings, including curing compounds, and other substances that are incompatible with adhesives and that contain soap, wax, oil, or silicone, without using solvents. Use mechanical methods recommended in writing by adhesive and carpet tile manufacturers.
- D. Broom and vacuum clean substrates to be covered immediately before installing carpet tile.

3.3 INSTALLATION

- A. General: Comply with CRI's "CRI Carpet Installation Standard," Section 18, "Modular Carpet" and with carpet tile manufacturer's written installation instructions.
- B. Installation Method: As recommended in writing by carpet tile manufacturer.
- C. Maintain dye-lot integrity. Do not mix dye lots in same area.
- D. Maintain pile-direction patterns recommended in writing by carpet tile manufacturer.
- E. Cut and fit carpet tile to butt tightly to vertical surfaces, permanent fixtures, and built-in furniture including cabinets, pipes, outlets, edgings, thresholds, and nosings. Bind or seal cut edges as recommended by carpet tile manufacturer.
- F. Extend carpet tile into toe spaces, door reveals, closets, open-bottomed obstructions, removable flanges, alcoves, and similar openings.
- G. Maintain reference markers, holes, and openings that are in place or marked for future cutting by repeating on carpet tile as marked on subfloor. Use nonpermanent, nonstaining marking device.
- H. Install pattern parallel to walls and borders.
- I. Protect carpet tile against damage from construction operations and placement of equipment and fixtures during the remainder of construction period. Use protection methods indicated or recommended in writing by carpet tile manufacturer.

END OF SECTION 096813

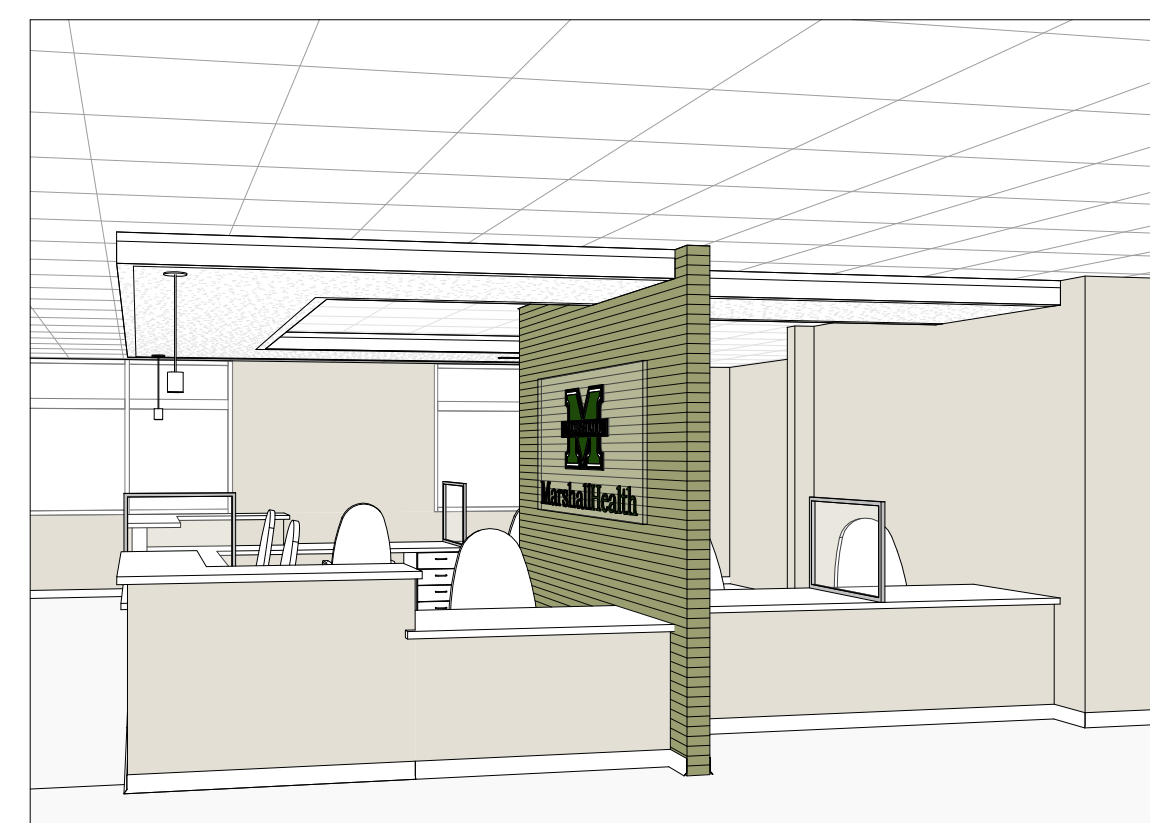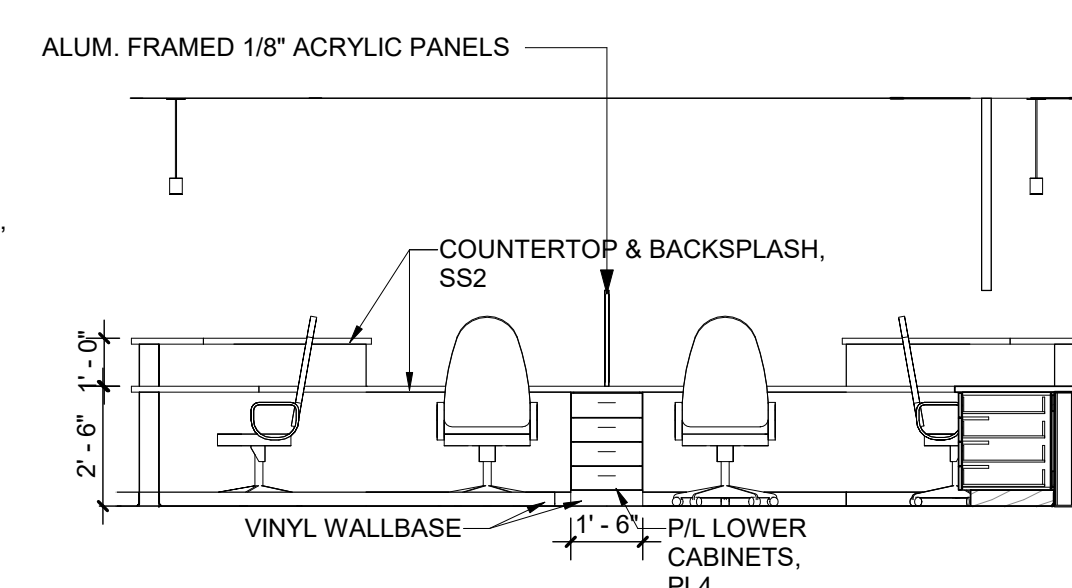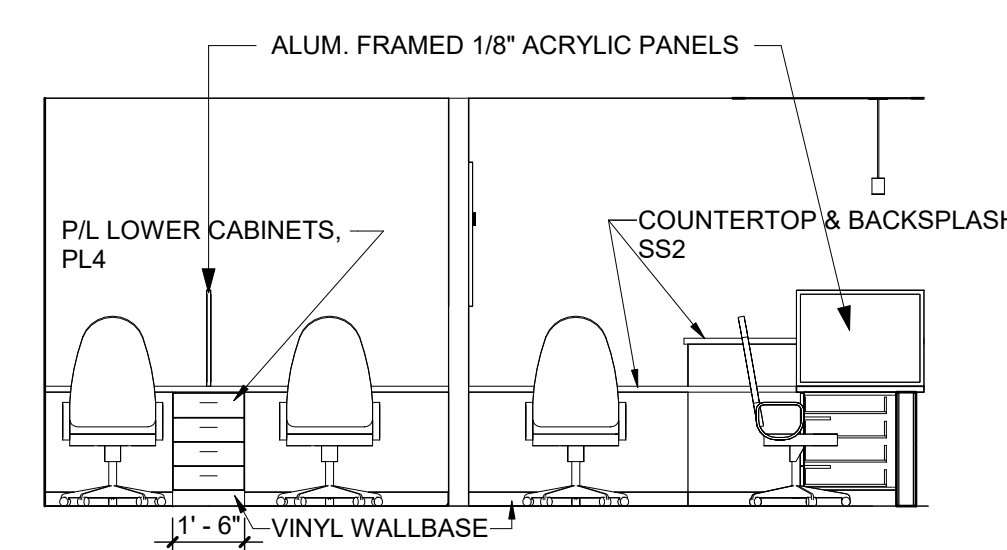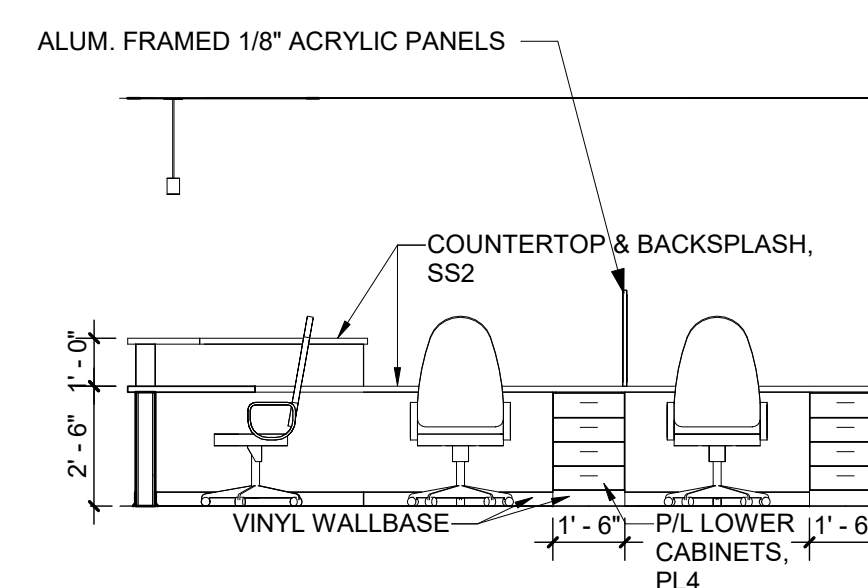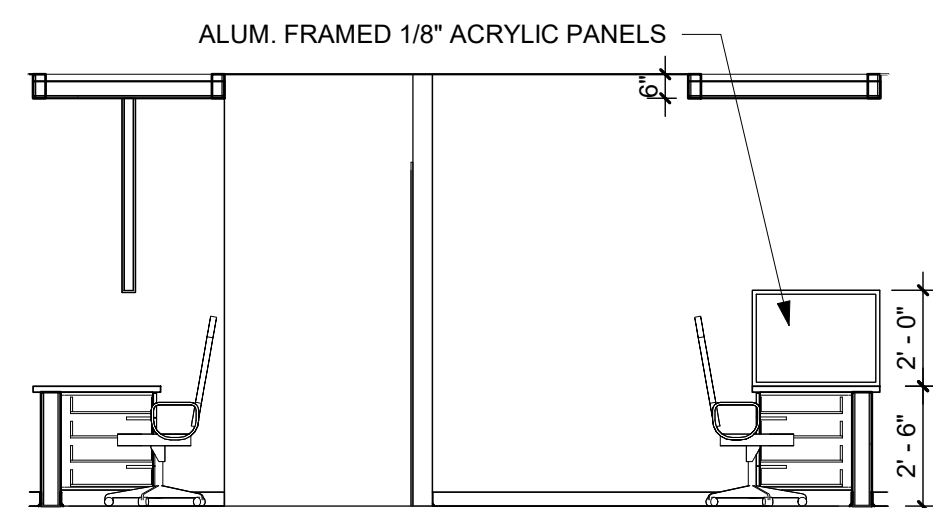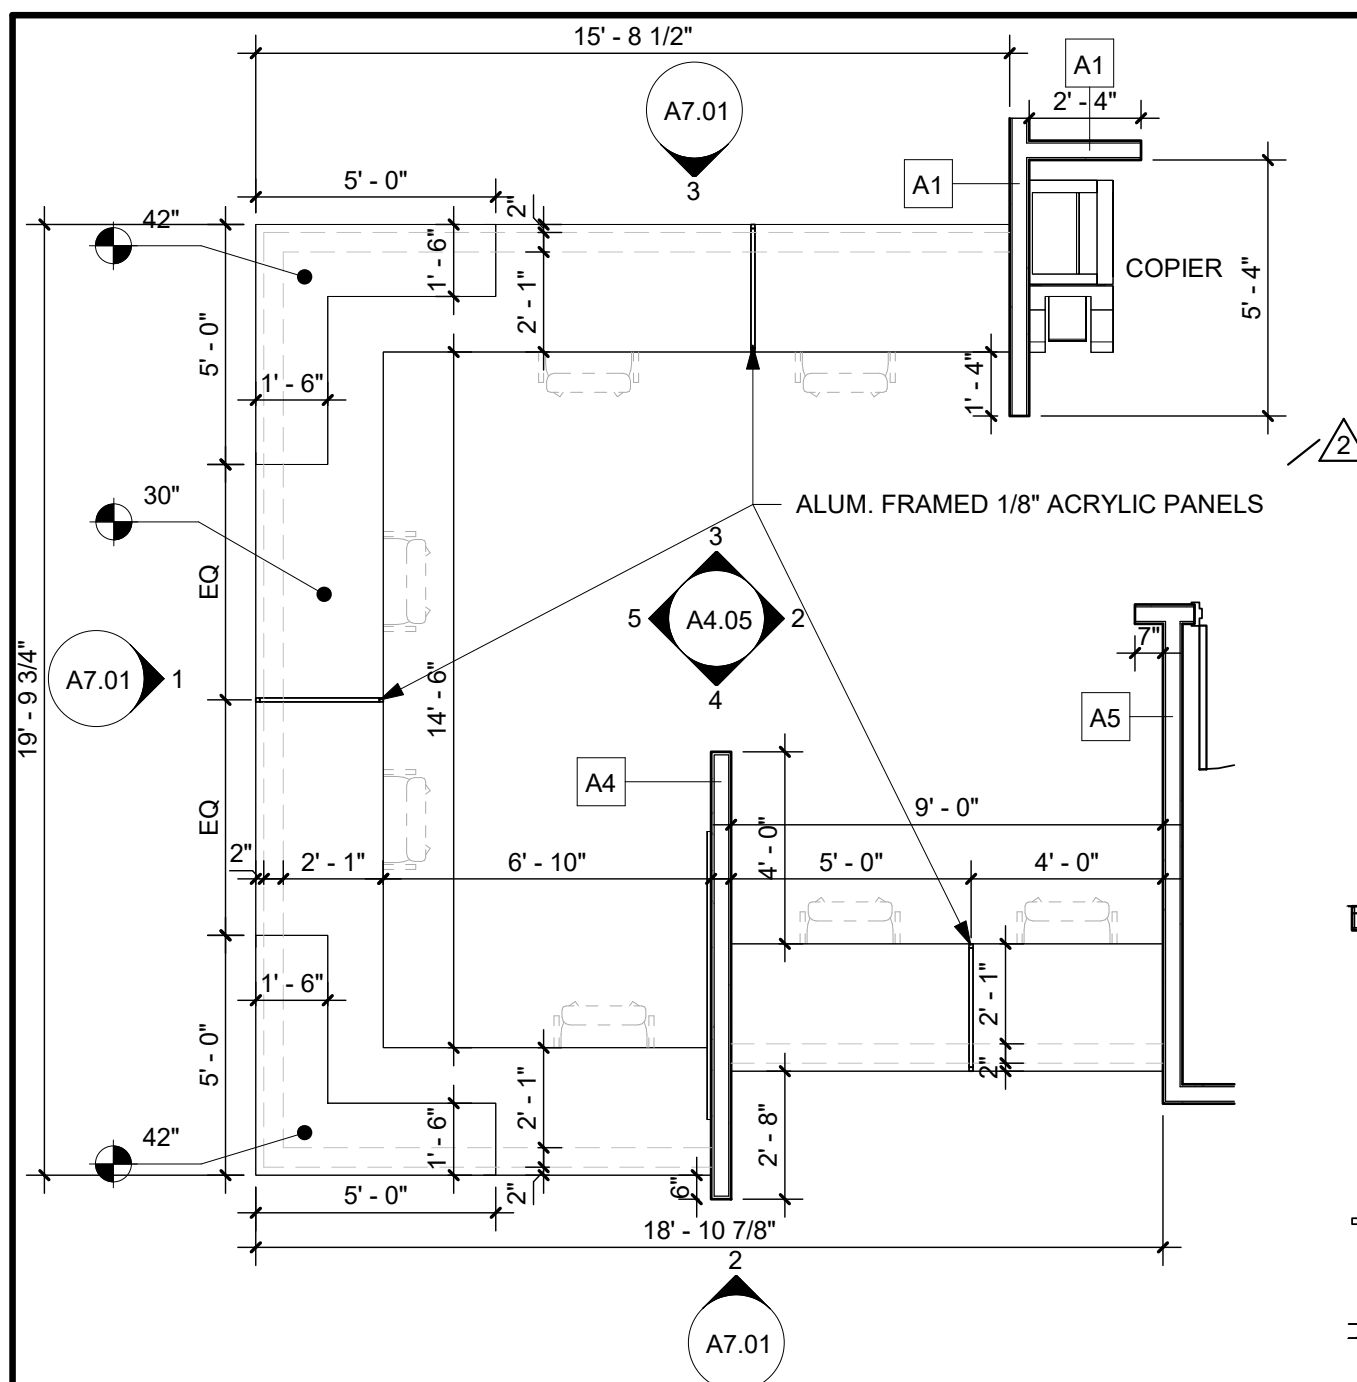

– 3D IMAGES ARE FOR REFERENCE PURPOSES ONLY

GENERAL INTERIOR ELEVATION NOTES


1. FURNITURE AND EQUIPMENT ARE SHOWN FOR REFERENCE ONLY. OWNER SHALL PROVIDE FURNITURE AND EQUIPMENT.
2. PROVIDE PIPE PROTECTORS AT ALL EXPOSED SUPPLY AND WATER PIPING.
3. REFER TO A5.01 FOR PARTITION TYPES.
4. REFER TO A5.02 FOR CASEWORK DETAILS.

CASEWORK FINISH LEGEND	
NOTE NUMBER	DESCRIPTION
PL1	FORMICA - NATURAL WHITE - SCULPTED FINISH - 918-SP
PL2	FORMICA - FOSSIL WATTI - MATTE COLLECTION - 5349-58
PL3	FORMICA - OTTER - GLOSS COLLECTION - 3202-90
PL4	FORMICA - EARTHEN WARP - MATTE COLLECTION - 5880-58
PL5	FORMICA - FOSSIL - SCULPTED FINISH - 5349-SP
PL6	FORMICA - WHEAT STRAND - MATTE COLLECTION - 6212-58
SS1	FORMICA - BIANCO MINERAL - DESIGNER SERIES
SS2	FORMICA - LUNA SAND - CLASSIC SERIES


[illegible]

ROOM FINISH SCHEDULE										
ROOM #	ROOM NAME	FLOOR FINISH	BASE	WALL FINISH				CEILING HEIGHT	CEILING FINISH	REMARKS
				NORTH	EAST	SOUTH	WEST			
101	CORRIDOR	FL3, FL4, FL5	WB1	PT1	PT1	PT1	PT1	9'-0"	ACT	
102	ELECTRICAL	FL1	WB2	PT1	PT1	PT1	PT1	EXP.	N/A	
103	DATA	FL1	WB2	PT1	PT1	PT1	PT1	EXP.	N/A	
104	CORRIDOR	FL3, FL4, FL5	WB1	PT1	PT1	PT1	PT1	9'-0"	ACT	
105	OFFICE	FL1	WB1	PT3	PT1	PT1	PT1	9'-0"	ACT	
106	NURSE STATION	FL3, FL4, FL5	WB1	PT1	PT1, PT6	PT1	PT1	9'-0"	ACT	
107	OFFICE	FL1	WB1	PT3	PT1	PT1	PT1	9'-0"	ACT	
108	EXAM	FL3, FL4, FL5	WB1	PT1, PT6	PT1	PT1	PT1	9'-0"	ACT	
109	EXAM	FL3, FL4, FL5	WB1	PT1, PT6	PT1	PT1	PT1	9'-0"	ACT	
110	DIRTY	FL3	WB2	PT1	PT1	PT1	PT1	9'-0"	ACT	
111	EXAM	FL3, FL4, FL5	WB1	PT1	PT1	PT1, PT6	PT1	9'-0"	ACT	
112	CLEAN	FL3	WB2	PT1	PT1	PT1	PT1	9'-0"	ACT	
113	EXAM	FL3, FL4, FL5	WB1	PT1	PT1	PT1, PT6	PT1	9'-0"	ACT	
114	EXAM	FL3, FL4, FL5	WB1	PT1, PT6	PT1	PT1	PT1	9'-0"	ACT	
115	SPRINKLER	FL8	WB2	PT1	PT1	PT1	PT1	EXP.	N/A	
116	EXAM	FL3, FL4, FL5	WB1	PT1	PT1	PT1, PT6	PT1	9'-0"	ACT	
117	VITALS	FL3	WB1	PT1	PT1	PT6	PT1	9'-0"	ACT	
118	NURSE STATION	FL3, FL4, FL5	WB1	PT1	PT1	PT1, PT6	PT1	9'-0"	ACT	
119	RESTROOM	FL7	WB1	T2	PT1	PT1	PT1	9'-0"	GWB	
120	VESTIBULE	FL6	WB3	PT1	PT1	PT1	PT1	9'-0"	GWB	
121	WAITING	FL1	WB1	PT1	PT1	PT1, T1	PT1	9'-0"	ACT	
122	RECEPTION/CHECKOUT	FL1	WB1	PT1	T1, PT1	PT1	PT1	VARIES	VARIES	
123	CORRIDOR	FL3, FL4, FL5	WB1	PT1	PT1	PT1	PT1	9'-0"	ACT	
124	EXAM	FL3, FL4, FL5	WB1	PT1	PT1, PT6	PT1	PT1	9'-0"	ACT	
125	EXAM	FL3, FL4, FL5	WB1	PT1	PT1, PT6	PT1	PT1	9'-0"	ACT	
126	EXAM	FL3, FL4, FL5	WB1	PT1	PT1, PT6	PT1	PT1	9'-0"	ACT	
127	EXAM	FL3, FL4, FL5	WB1	PT1	PT1	PT1	PT1, PT6	9'-0"	ACT	
128	EXAM	FL3, FL4, FL5	WB1	PT1	PT1	PT1	PT1, PT6	9'-0"	ACT	
129	EXAM	FL3, FL4, FL5	WB1	PT1	PT1, PT6	PT1	PT1	9'-0"	ACT	
130	NURSE STATION	FL3, FL4, FL5	WB1	PT1	PT1, PT6	PT1	PT1, PT6	VARIES	VARIES	
131	EXAM	FL3, FL4, FL5	WB1	PT1	PT1	PT1	PT1, PT6	9'-0"	ACT	
132	OFFICE	FL1	WB1	PT1	PT1	PT3	PT1	9'-0"	ACT	
133	EXAM	FL3, FL4, FL5	WB1	PT1	PT1, PT6	PT1	PT1	9'-0"	ACT	
134	PROCESSING	FL3	WB2	PT1	PT1	PT1	PT1	9'-0"	ACT	
135	CLEAN	FL3	WB2	PT1	PT1	PT1	PT1	9'-0"	ACT	
136	CRYO	FL3	WB1	PT1	PT1	PT1	PT1	9'-0"	ACT	
137	PROCEDURE	RS1	RS1	PT1	PT1, PT6	PT1	PT1	9'-0"	ACT	
138	MEDS	FL3	WB1	PT1	PT1	PT1	PT1	9'-0"	ACT	
139	PROCEDURE	RS1	RS1	PT1	PT1, PT6	PT1	PT1	9'-0"	ACT	
140	NURSE STATION	FL3, FL4, FL5	WB1	PT1	PT1	PT1	PT1, PT6	9'-0"	ACT	
141	PROCEDURE	RS1	RS1	PT1	PT1	PT1, PT6	PT1	9'-0"	ACT	
142	MOHS LAB	FL3	WB2	PT1	PT1	PT1	PT1	9'-0"	ACT	
143	LAB SUPPLY	FL3	WB2	PT1	PT1	PT1	PT1	9'-0"	ACT	
144	STORAGE	FL3	WB2	PT1	PT1	PT1	PT1	9'-0"	ACT	
145	DIRTY	FL3	WB2	PT1	PT1	PT1	PT1	9'-0"	ACT	
146	STAFF ENTRY	FL6	WB3	PT1	PT1	PT1	PT3	9'-0"	ACT	
147	STORAGE	FL3	WB2	PT1	PT1	PT1	PT1	9'-0"	ACT	
148	RECEIVING/ACCESSIONING	FL3	WB1	PT1	PT1	PT1	PT1	9'-0"	ACT	
149	TOXICOLOGY TECH WORKROOM	FL3	WB1	PT1	PT1	PT1	PT1	9'-0"	ACT	
150	TOXIC COORD	FL1	WB1	PT1	PT3	PT1	PT1	9'-0"	ACT	
151	TOXICOLOGY DIRECTOR	FL1	WB1	PT1	PT3	PT1	PT1	9'-0"	ACT	
152	TOXICOLOGY LAB	FL3, FL1	WB2	PT1	PT1, PT6	PT1	PT1	9'-0"	ACT	
153	STORAGE	FL3	WB2	PT1	PT1	PT1	PT1	9'-0"	ACT	
154	CORRIDOR	FL3, FL4, FL5	WB1	PT1	PT1	PT1	PT1	9'-0"	ACT	
155	RESTROOM	FL7	WB1	PT1	PT1	PT1	T2	9'-0"	GWB	
156	RESTROOM	FL7	WB1	PT1	T2	PT1	PT1	9'-0"	GWB	
157	NURSE STATION	FL3, FL4, FL5	WB1	PT1	PT1	PT1	PT1, PT6	9'-0"	ACT	
158	EXAM	FL3, FL4, FL5	WB1	PT1, PT6	PT1	PT1	PT1	9'-0"	ACT	
159	CLEAN	FL3	WB2	PT1	PT1	PT1	PT1	9'-0"	ACT	
159A	GAS STORAGE	FL3	WB2	PT1	PT1	PT1	PT1	9'-0"	ACT	
160	EXAM	FL3, FL4, FL5	WB1	PT1, PT6	PT1	PT1	PT1	9'-0"	ACT	
161	DIRTY	FL3	WB2	PT1	PT1	PT1	PT1	9'-0"	ACT	
162	EXAM	FL3, FL4, FL5	WB1	PT1	PT1	PT1, PT6	PT1	9'-0"	ACT	
163	MECHANICAL	FL8	WB2	PT1	PT1	PT1	PT1	EXP.	N/A	
164	RESTROOM	FL7	WB1	PT1	PT1	PT1	T2	9'-0"	GWB	
165	BREAK ROOM	FL3, FL5	WB1	PT1	PT1	PT1	PT1	9'-0"	ACT	
166	STORAGE	FL8	WB2	EX	PT1	PT1	PT1	EXP.	N/A	
167	RESTROOM	FL7	WB1	PT1	T2	PT1	T2	9'-0"	EX	
168	RESTROOM	FL7	WB1	PT1	T2	PT1	T2	9'-0"	EX	
169	H.K.	FL1	WB2	PT1	PT1	PT1	PT1	EXP.	N/A	


USER: AUB
8/11/23 5:52 AM

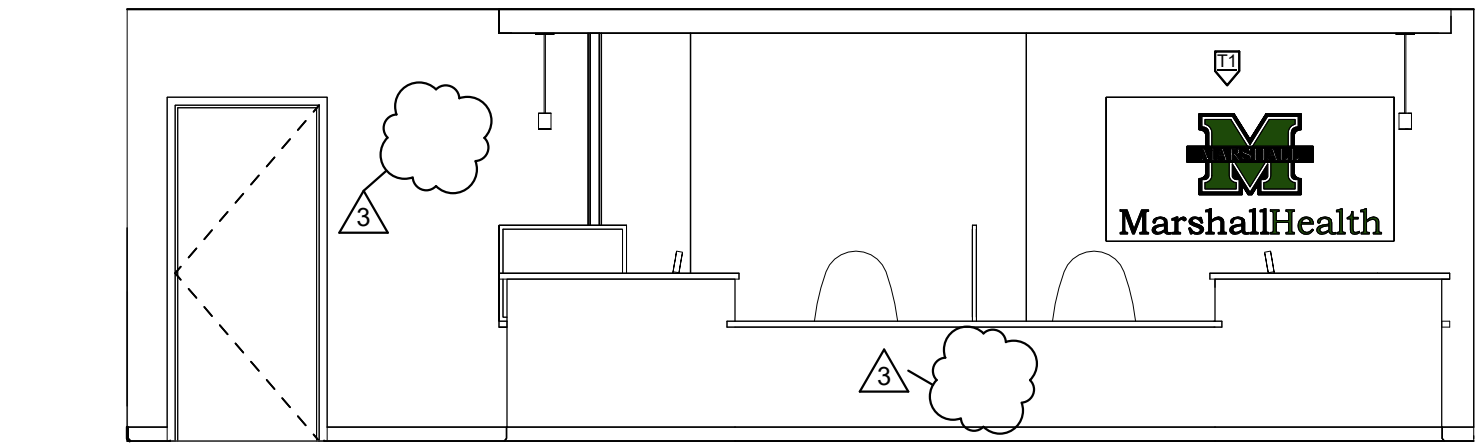


1 RECEPTION/CHECKOUT 122
A7.01 1/4" = 1'-0"

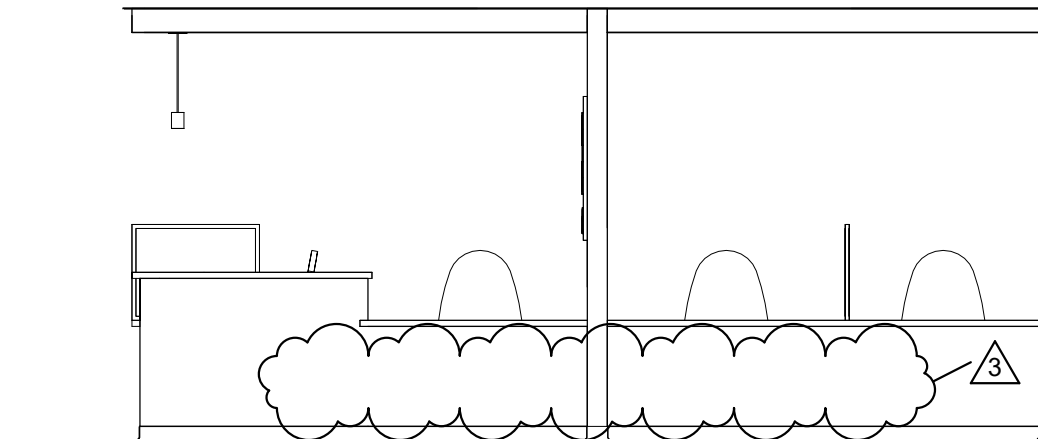


2 RECEPTION/CHECKOUT 122
A7.01 1/4" = 1'-0"

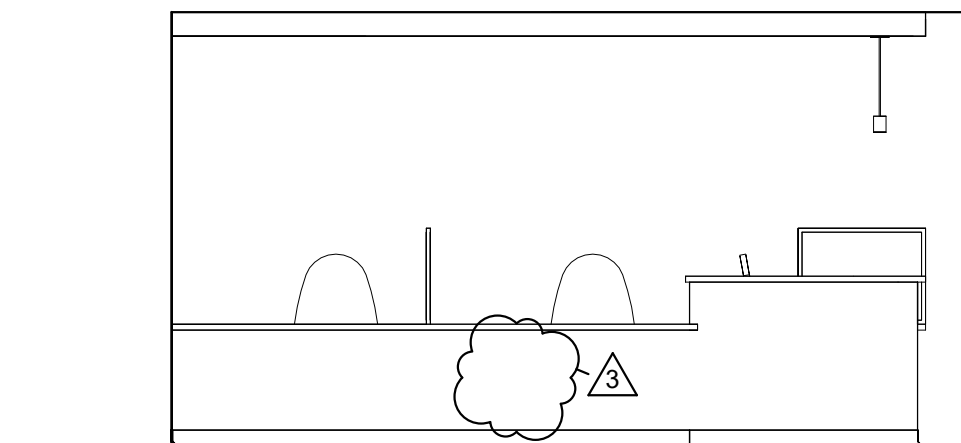


3 RECEPTION/CHECKOUT 122
A7.01 1/4" = 1'-0"

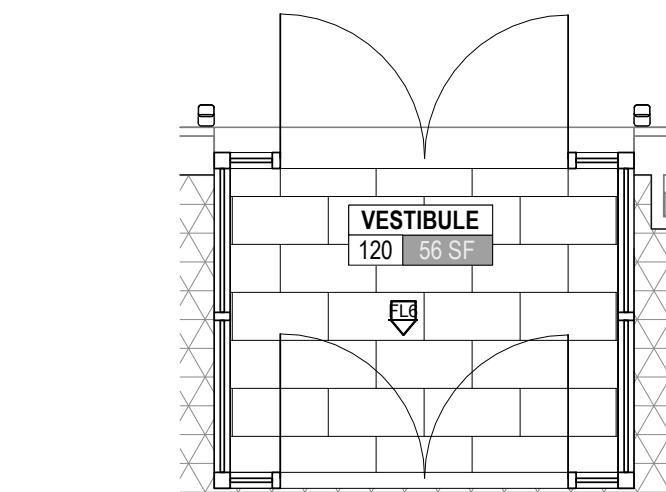


7 VESTIBULE 120 FLOOR FINISH
A7.01 1/4" = 1'-0"

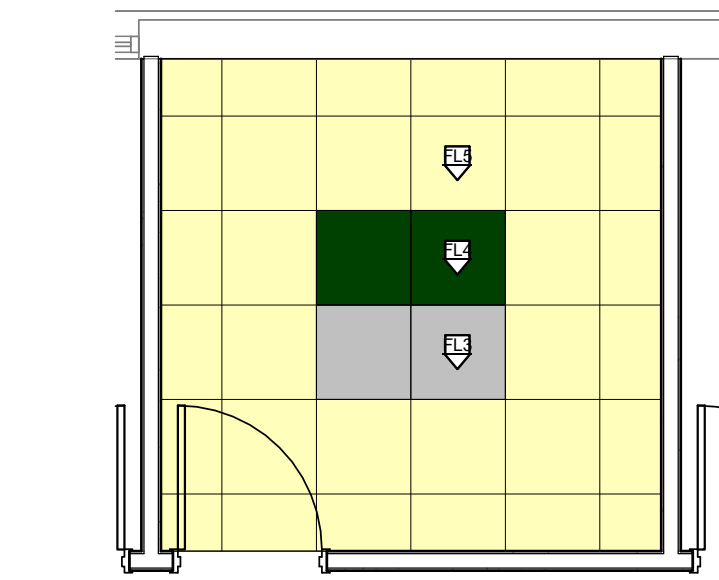


4 TYPICAL EXAM FLOOR PATTERN 1
A7.01 1/4" = 1'-0"

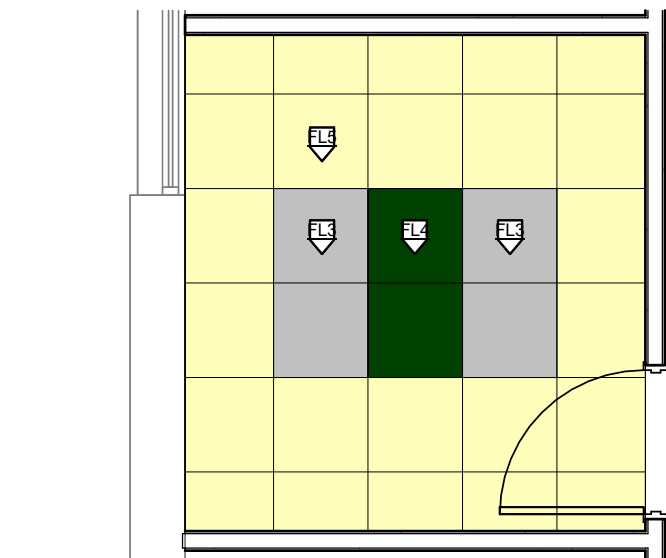

5 TYPICAL EXAM FLOOR PATTERN 2
A7.01 1/4" = 1'-0"

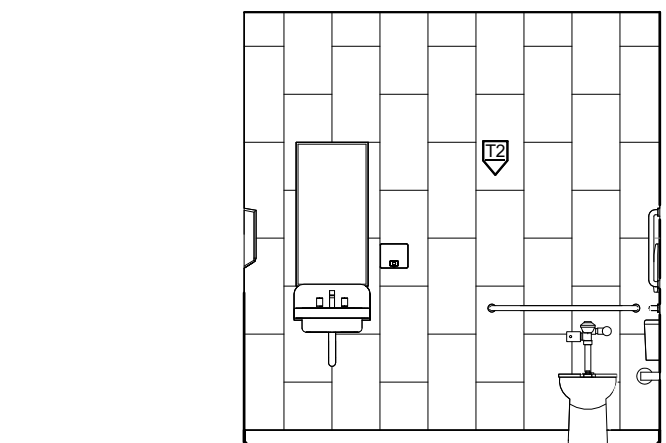

6 TYPICAL RESTROOM TILE PATTERN
A7.01 1/4" = 1'-0"

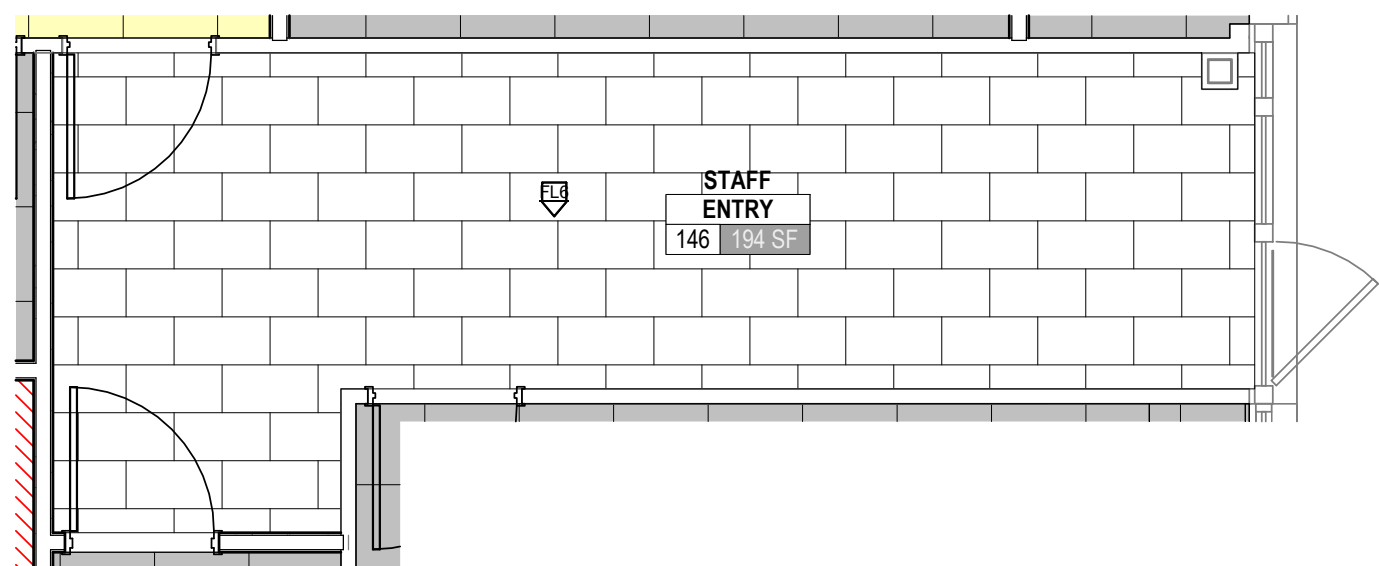


8 STAFF ENTRY 146 FLOOR FINISH
A7.01 1/4" = 1'-0"

GENERAL FINISH NOTES

- FLOOR FINISH CONTINUES UNDER ALL CASEWORK, OPEN COUNTERS, FURNITURE, FIXTURES AND EQUIPMENT.
- WHERE FLOOR MATERIAL CHANGES IN DOORWAYS, PLACE TRANSITION UNDERNEATH DOOR LEAF.
- SEE CASEWORK ELEVATIONS FOR WALL FINISH LOCATIONS.
- ALL CEILING PAINT TO BE FLAT FINISH.

FLOOR FINISH LEGEND

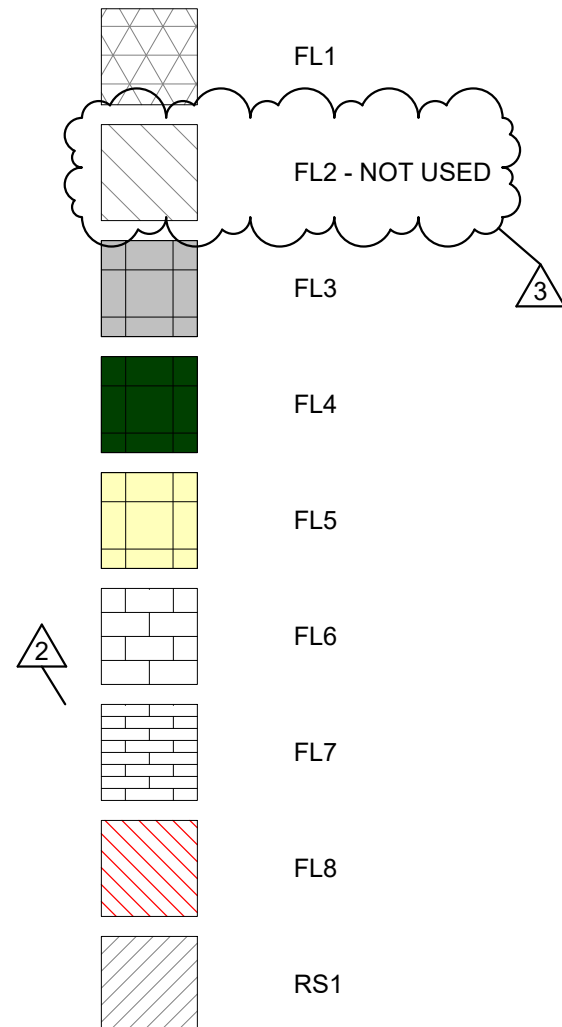

FINISH LEGEND

NOTE NUMBER	DESCRIPTION
FL1	INTERFACE - SHIVER ME TIMBERS - SYCAMORE 103922
FL2	NOT USED
FL3	PATCRAFT - TYPOGRAPHY - TYPEFACE - SCRIPT 00538
FL4	PATCRAFT - TYPOGRAPHY - LETTERPRESS - UPPERCASE 00380
FL5	PATCRAFT - TYPOGRAPHY - TYPEFACE - BASELINE 00100
FL6	FLORIDA PORCELAIN TILES - COCONUT SHELL - 12"x24"
FL7	STONE PEAK PORCELAIN TILES - CREATE COLLECTION - COLONIAL WHITE - 6"x24"
FL8	SEALED CONCRETE
PT1	BM1548 CLASSIC GREY
PT2	NOT USED
PT3	NOT USED
PT4	NOT USED
PT5	NOT USED
PT6	SW 9137 NIEBLA AZUL - STAIN
PT7	NOT USED
RS1	PATCRAFT - HOLISTIC SHADES - TRANQUIL 00105
T1	UNMADA BAY TILE - ALUCE ANTRICURE SHK - FIN (1-1/4"x5-1/8" - 1-1/4"x5-2/3")
T2	AMERICAN OLEAN - CLAY CANVAS - CHALK CC01 - MATTE (2) - 12"x24"
WB1	JOHNSONITE - WALLBASE - MOON ROCK - 6"
WB2	JOHNSONITE - VINYL COVE - MOON ROCK - 4"
WB3	FLORIDA PORCELAIN TILES - COCONUT SHELL - 3"x24" BULLNOSE

THRASHER
600 WHITE OAKS BLVD.
P.O. BOX 940
BRIDGEPORT, WV 26330
P (304) 624-4108
F (304) 624-7831
www.thrashergroup.com

THE INFORMATION CONTAINED HEREIN IS THE SOLE PROPERTY OF THE THRASHER GROUP, INC. REPRODUCTION OF THESE DOCUMENTS IN WHOLE, OR IN PART FOR ANY REASON WITHOUT PRIOR WRITTEN PERMISSION IS STRICTLY PROHIBITED.
COPYRIGHT © 2023
THE THRASHER GROUP, INC.



NO.	BY	DATE	DESCRIPTION
1	ALB	03/15/24	ADDENDUM 2
2	ALB	03/15/24	ADDENDUM 3
3	ALB	03/15/24	ADDENDUM 3

MARSHALL HEALTH FORMER STRAYER BUILDING RENOVATIONS
MARSHALL HEALTH
SCOTT DEPOT, WV
FEBRUARY 22, 2024
CONSTRUCTION DOCUMENTS

DRAWN: ALB DATE: 02/22/24
CHECKED: CCA DATE: 02/22/24
PROJECT No.
T60-11110

FINISHED FLOOR SCHEDULE

SHEET No.

A7.01

